


2. Part Names and Settings

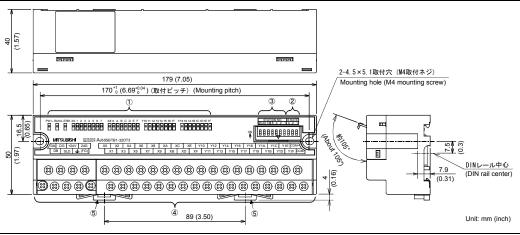

No.	名称	内 容			
		LED名	確認内容		
	動作表示 LED	PW	点灯: 電源ON。 消灯: 電源OFF。		
		L RUN	点灯: 交信正常時。 消灯: 交信断時 (タイムオーバエラー)。		
1		L ERR.	点灯: 交信エラー時。 一定間隔で点滅: 通電中に局番設定/伝送速度設定スイッチの設定を変更したとき。 不定間隔で点滅: 終端抵抗の設定が違っているとき。ユニット、CC-Link専用ケーブルがノイズの影響を受けているとき。 消灯: 交信正常時。		
		X0∼F Y10∼1F	点灯: 入出力ON。 消灯: 入出力OFF。		
2	伝送速度 設定	設定値 0 1 2 3 4 伝送速度	設定スイッチ状態 伝送速度 4 2 1 伝送速度 1 156 kbps OFF OFF OFF ON 625 kbps OFF ON OFF 2.5 Mbps OFF ON ON 5.0 Mbps ON OFF OFF 10 Mbps ON OFF OFF OFF OFF OFF OFF OFF OFF OFF		
3	局番設定 スイッチ	STATION NO.の "10", "20", "40" で局番の10の位を 設定します。 STATION NO.の "1", "2", "4", "8" で局番の1の位 を設定します。 局番は必ず1~64の範囲で設定してください。(*1) (例) 局番を "32" に設定するときは、下記のようにス イッチ設定を行います。 			
4	端子台	入出力ユー です。	ニット電源,伝送,入出力信号の接続用端子台		
5	DIN レール用 フック	ユニット	をDINレールに取り付けるときにDINレール用 中心線上を指でカチッと音がするまで押さえ		

* 1	局番は重複	1.て設定できません。

						Unit: mm (inch)
No.	Item	Description				
		LED name Confirmation details				
		PW	ON: Powe	er supply	ON.	
		OFF: Power supply OFF.				
			ON: Norm			
		L RUN	OFF: Communication shut off			
			(time expiration error). ON: Communication data error.			
	Operating		Flash at re			1101.
(1)	status					n number settina
(I)	indicator					setting switch
	LEDs	L ERR.				while power is ON
		L LIVIV	Flash at in			
						e terminal resistor le for the module
					affected I	
			OFF: Non			
		X0 to F	ON: Input			
		Y10 to 1F	OFF: Inpu	ıt/Output	OFF.	
		Setting	Settin	g switch	status	Transmission
		value	4	2	1	speed
	Trans-	0	OFF	OFF	OFF	156 kbps
(2)	mission	1	OFF	OFF	ON	625 kbps
•	speed setting	2	OFF	ON	OFF	2.5 Mbps
		3	OFF	ON	ON	5.0 Mbps
		A De aura ta a	ON ON	OFF	OFF	10 Mbps vithin the above
		range.	set the tran	SITIISSIOI	i speed w	itilii tile above
		Select "10",	"20" or "40	" to set t	the tens p	lace of the
	Station number	station num				
		Select "1", "2", "4" or "8" to set the ones place of the station				
		number. Always set the station number within the range of 1 to 64.				
		(*1)				
3	setting	(Example) Set the switches as below when setting the				
	switches	station number to 32:				
		Station	Tens p			nes place
		number	40 20	10		4 2 1
					FF ON OFF	
(4)	Terminal				ower supply,	
•	block transmission and I/O signals. When the module is installed to the DIN rail, pu					
(5)	Hook for					
9	DIN rail	center line of the hook for DIN rail with a finger tip until a clicking sound is heard.				

^{*1} Duplicate station number cannot be set.

MITSUBISHI ELECTRIC CORPORATION | MA | AJ65SBTB1-32DT3-U

IB-0800209-F

AJ65SBTB1-32DT3 形 CC-Link システム小形タイプリモート I/O ユニットユーザーズマニュアル AJ65SBTB1-32DT3 CC-Link System Compact Type Remote I/O Module User's Manual

● 安全上のご注意 ●

(ご使用前に必ずお読みください)

本製品のご使用に際しては、本マニュアルをよくお読みいただくと 共に、安全に対して十分に注意を払って、正しい取扱いをしていただ くようお願いいたします。

なお、この注意事項は本製品に関するもののみについて記載したも のです。シーケンサシステムとしての安全上のご注意に関しては、CPU ユニットのユーザーズマニュアルを参照してください。

この●安全上のご注意●では、安全注意事項のランクを「危険」、 「注意」として区分してあります。

取扱いを誤った場合に、 危険な状況が起こり えて、死亡または重傷を受ける可能性が想定 される場合。



取扱いを誤った場合に、危険な状況が起こり えて, 中程度の傷害や軽傷を受ける可能性が 想定される場合および物的損害だけの発生が 想定される場合。

なお. ⚠ 注意に記載した事項でも、状況によっては重大な結果に 結びつく可能性があります。

いずれも重要な内容を記載していますので必ず守ってください。 本マニュアルは必要なときに読めるように大切に保管すると共に 必ず最終ユーザまでお届けいただくようにお願いいたします。

【設計上の注意事項】

<!><!>< } 険

● データリンクが交信異常になったとき、交信異常局は次のような状態になり

交信状態情報を使って、システムが安全側に働くようにシーケンスプログラ ム上でインタロック回路を構成してください。 誤出力、誤動作により事故の恐れがあります。

- (1) リモートI/0局からの入力は、全点OFFします。
- (2) リモートI/O局からの出力は、全点OFFします。
- リモートI/Oユニットの故障によっては、入出力がON状態またはOFF状態にな ることがあります。重大な事故につながるような入出力信号については、外 部で監視する回路を設けてください。

⚠注 意

- ユニットは、CPUユニットユーザーズマニュアル記載の一般仕様の環境で使 用してください。 一般仕様の範囲以外の環境で使用すると、感電、火災、誤動作、製品の損傷
- あるいは劣化の原因になります。
- 制御線や通信ケーブルは、主回路や動力線などと束線したり、近接したりし ないでください。
- 100mm以上を目安として離してください。 ノイズにより、誤動作の原因になります。

【取付け上の注意事項】

- ユニットの導電部分には直接触らないでください。 ユニットの誤動作、故障の原因になります。
- ユニットは、DINレールまたは取付けネジにて、確実に固定し、取付けネジ は規定トルク範囲内で確実に締め付けてください。 ネジの締付けがゆるいと、落下、短絡、誤動作の原因になります。 ネジを締め過ぎると、ネジの破損による落下、短絡の原因になります。

【配線上の注意事項】

① 危 険

配線作業などは、必ずシステムで使用している外部供給電源を全相遮断して から行ってください。全相遮断しないと、感電あるいは製品の損傷の恐れが あります。

SAFETY PRECAUTIONS

(Read these precautions before using.)

When using this equipment, thoroughly read this manual. Also pay careful attention to safety and handle the module properly. These precautions apply only to this equipment. Refer to the CPU module user's manual for a description of the PLC system safety

These ■ SAFETY PRECAUTIONS ■ classify the safety precautions into two categories: "DANGER" and "CAUTION".



Procedures which may lead to a dangerous condition and cause death or serious injury if not carried out properly.

CAUTION

Procedures which may lead to a dangerous condition and cause superficial to medium injury, or physical damage only, if not carried out properly.

Depending on circumstances, procedures indicated by \triangle CAUTION may also result in to serious results.

In any case, it is important to follow the directions for usage Store this manual in a safe place so that you can take it out and read it whenever necessary. Always forward it to the end user.

(0706) MEE

[DESIGN PRECATUIONS]

(!)DANGER

- When a communication error occurs in the data link, the communication error station will be in the following condition. Configure an interlocking circuit in a sequence program using the communication status information so that the safety of the overall system is always maintained. Accident may occur due to output error or malfunction.
- (1) Input points from remote I/O station will be all switched off. (2) Output points from remote I/O station will be all switched off.
- I/O could be switched on or off when a problem occurs in the remote I/O modules. So build an external monitoring circuit that will monitor any I/O signals that could cause a serious accident.

∴CAUTION

- Use each module in an environment as specified in the "general specification" in the CPU module user's manual. Usage of the module outside the general specification range may cause electric shock, fire. malfunction, product damage or deterioration.
- Do not have control cables and communication cables bundled with or placed near by the main circuit and/or power cables. Wire those cables at least 100mm (3.94 inch) away from the main circuit and/or power cables. It may cause malfunction due to noise interference.

[INSTALLATION PRECAUTIONS]

\wedge CAUTION

- Do not directly touch the module's conductive parts. Doing so could cause malfunction or trouble in the module.
- Tighten the module securely using DIN rail or installation screws within the specified torque range. Loose terminal screws may cause a short circuit or erroneous operation. If the terminal screws are too tight, it may cause falling, short circuit or erroneous operation due to damage of the screws.

[WIRING PRECAUTIONS]

(!)DANGER

 Completely turn off the externally supplied power used in the system when installing or placing wiring. Not completely turning off all power could result in electric shock or damage to the product.

♠注 意

- FG端子はシーケンサ専用のD種接地(第三種接地)以上で必ず接地を行って ください。感電、誤動作の恐れがあります。
- 空き端子ネジは必ず締付けトルク範囲 (42~50N·cm) で締付けてください。
- 圧着端子と短絡する原因になります。 圧着端子は適合圧着端子を使用し、規定のトルクで締付けてください。 先開形圧着端子を使用すると、端子ネジがゆるんだ場合に脱落し、故障の原 因になります
- ユニットの配線は、製品の定格電圧および端子配列を確認した上で正しく行
- 定格と異なった電源を接続したり、誤配線すると、火災、故障の原因になり
- 端子ネジの締付けは、規定トルク範囲内で行ってください。
- 端子ネジの締付けがゆるいと、火災や誤動作の原因になります。
- 端子ネジを締め過ぎると、ネジの破損による短絡、誤動作の原気になります。 ユニット内に、切粉や配線クズなどの異物が入らないように注意してください。 火災、故障、誤動作の原因になります。
- ユニットに接続する電線やケーブルは、必ずダクトに納める、またはクラン プによる固定処理を行ってください。 ケーブルをダクトに納めなかったり、クランプによる固定処理をしていない
- ケーブルのブラツキや移動、不注意の引っ張りなどによるユニットやケ ーブルの破損、ケーブルの接触不良による誤動作の原因となります。 ● 制御線と通信ケーブルは束線したり、近接したりしないでください。
- ノイズにより、誤動作の原因になります。
- ユニットに接続されたケーブルを取り外すときは、ケーブル部分を手に持っ て引っ張らないでください。
- コネクタ付きのケーブルは、ユニットに接続している部分のコネクタを手で 持って取り外してください。コネクタなしのケーブルは、ユニットに接続している部分のネジを緩めてから取り外してください。
- ユニットに接続された状態でケーブルを引っ張ると、ユニットやケーブルの 破損、ケーブルの接続不良による誤動作の原因となります

【立上げ・保守時の注意事項】

!)危 険

- 通電中に端子に触れないでください。感電の原因になります。
- 清掃, 端子ネジ, ユニット取付けネジの増し締めは, 必ずシステムで使用し ている外部供給電源を全相遮断してから行ってください。全相遮断しない ユニットの故障や誤動作の原因になります。

♪注 意

- ユニットの分解、改造はしないでください。 故障、誤動作、ケガ、火災の原因になります。
- ユニットは落下させたり、強い衝撃を与えないでください。
- ユニットの破損の原因になります。
- ユニットの盤への取付け・取外しは必ずシステムで使用している外部供給電 源を全相遮断してから行ってください。全相遮断しないと、ユニットの故障 や誤動作の原因になります。
- 端子台の着脱は、製品ご使用後、50回以内としてください。 (JIS B 3502準拠)
- ユニットに触れる前には、必ず接地された金属などに触れて、人体などに帯 電している静電気を放電してください。
- 静電気を放電しないと、ユニットの故障や誤動作の原因になります。

【廃棄時の注意事項】

♪注 意

● 製品を廃棄するときは、産業廃棄物として扱ってください。

1 4 拦

Ι.	. 1上1來		
項目			内容
	入力点数		16点
	絶縁方式		フォトカプラ絶縁
	定格入力電圧		DC24V
	定格入力電流		約5mA
٠.	使用電圧範囲		DC19.2~26.4V(リップル率5%以内)
소	最大同時入力点数 ON電圧/ON電流	Ţ	100%
ᇄ	ON電圧/ON電流		15V以上/3.0mA以上
ш	UFF电压/UFF电流	Ē.	3V以下/0.5mA以下
	入力抵抗		約4.7kΩ
	応答時間	0FF→0N	0. 2ms以下 (DC24V時)
		ON→OFF	0. 2ms以下 (DC24V時)
	入力形式		プラスコモン(シンクタイプ)
	出力点数		16点
	絶縁方式		フォトカプラ絶縁
	定格負荷電圧		DC24V
	使用負荷電圧範囲		DC19.2~26.4V(リップル率5%以内)
田	最大負荷電流		0.5A/1点, 3.6A/1コモン
갦	最大負荷電流最大負荷突入電流	Ē.	1.0A 10ms以下
DIA	0FF時漏洩電流		0. 1mA以下
	ON時最大電圧降下		0. 3V以下(TYP.) 0. 5A,
			0.6V以下(MAX.) 0.5A
	出力形式		シンクタイプ

- Always ground the FG termina There is a risk of electric shock or malfunction
- Be sure to tighten any unused terminal screws within a tightening torque range (42 to 50 N·cm).
- Failure to do so may cause a short circuit due to contact with a solderless terminal.
- Use applicable solderless terminals and tighten them with the specified torque
- If any solderless spade terminal is used, it may be disconnected when the terminal screw comes loose, resulting in failure.
- Perform correct wiring for the module according to the product's rated voltage and terminal arrangement. Connecting to a power supply different from rating or miss-wiring may cause fire and/or product failure.
- Fix terminal screws securely within the regulated torque. Loose terminal screws may cause fire and/or malfunction. If the terminal screws are too tight, it may cause short circuit or erroneous
- operation due to damage of the screws. Make sure foreign objects do not get inside the module, such as dirt and wire chips. It may cause fire, product failure or malfunction.
- Be sure to fix the wires or cables by ducts or clamps when connecting them to the module. Failure to do so may cause damage of the module or the cables due to accidental pull or unintentional shifting of the cables, or malfunctions due to poor contact of the cable.
- Do not install the control lines together with the communication cables, or bring them close to each other. Failure to do so may cause malfunctions due to noise.
- When disconnecting a cable from the module, do not pull on the cable itself Disconnect cables not fitted with a connectors by holding and pulling the cable connector. Disconnect cables not fitted with a connector by removing the screws from the part connected to the module can cause damage to the module or cable, or malfunction due to cable connection faults.

[STARTING AND MAINTENANCE PRECAUTIONS]

(!)DANGER

- Do not touch terminals when the power is on. Doing so could cause an electric shock.
- Switch off all phases of the externally supplied power used in the system when cleaning the module or retightening the terminal or module mounting screws. Not doing so could result in electric shock.

^CAUTION

- Never try to disassemble of modify module. It may cause product failure, malfunction, fire or cause injury.
- Do not drop or apply any strong impact to the module. Doing so may damage the module.
- Completely turn off the externally supplied power used in the system before mounting or removing the module to/from the panel. Not doing so could result in damage to the product.
- Mounting/removing the terminal block is limited to 50 times after using a product. (IEC61131-2-compliant)
- Always make sure to touch the grounded metal to discharge the electricity charged in the electricity charged in the body, etc., before touching the module. Failure to do so may cause a failure or malfunctions of the module.

[DISPOSAL PRECAUTIONS]


When disposing of this product, treat it as industrial waste.

Specification

_	1. opcomoducii							
Item			Description					
	Number of input point	S	16 points					
	Isolation method		Photocoupler					
	Rated input voltage		24 V DC					
	Rated input current		Approx. 5 mA					
	Operating voltage ran	ge	19.2 to 26.4 V DC (ripple ratio: within 5 %)					
Ħ	Max. simultaneous ON	I input points	100 %					
Ę	ON voltage/ON currer	nt	15 V or higher/3.0 mA or higher					
	OFF voltage/OFF curr	ent	3 V or lower/0.5 mA or lower					
	Input resistance		Approx. 4.7 kΩ					
	Response time	OFF→ON	0.2 ms or lower (when 24 V DC)					
		ON→OFF	0.2 ms or lower (when 24 V DC)					
	Input form		Positive common (Sink type)					
	Number of output poir	nts	16 points					
	Isolation method		Photocoupler					
	Rated load voltage		24 V DC					
Ļ	Operating load voltage	e range	19.2 to 26.4 V DC (ripple ratio: within 5 %)					
Jutput	Max. load current		0.5 A/point 3.6 A/common					
Ĭ	Max. load inrush curre	ent	1.0 A 10 ms or lower					
Γ	Leakage current at Of	F	0.1 mA or lower					
ı	Max. voltage drop at 0	DNI .	0.3 V or lower (TYP.) 0.5 A,					
ı		JIN	0.6 V or lower (MAX.) 0.5 A					
L	Output form		Sink type					

		項目		内容			
	保護機能			なし			
	応答時間	ill Ill	0FF→0N	0.5ms以下			
出	NO CHALLEI		0N→0FF	1.5ms以下(抵抗負荷)			
出力部	出力部		電圧	DC19.2~26.4V(リップル率5%以内)			
部	外部供給	心雷酒	電流	24. 2mA以下(DC24V,全点ON時)			
			电测	外部負荷電流は含まず			
	サージ			ツェナーダイオード			
П	モン方式	t		32点1コモン(端子台形1線式)			
占	有局数			1局32点割付け(32点使用)			
1.7	0ユニッ	し亜油	電圧	DC20.4~26.4V(リップル率5%以内)			
17	04-9	P 电源	電流	60mA以下 (DC24V, 全点ON時)			
				DCタイプのノイズ電圧500Vp-p, ノイズ幅1µs,			
1	イズ耐量	1		ノイズ周波数25~60Hzのノイズシミュレータに			
				よる			
耐	雷圧			DC外部端子一括-アース間AC500V 1分間			
1117	电冮						
绐	緑抵抗			DC外部端子一括-アース間DC500V絶縁抵抗計に			
				て10MΩ以上			
	護等級			IP2X			
質	量			0. 25kg			
	通信部, 1/0ユニット電源部 計技			7点2ピース端子台			
				伝送回路, I/Oユニット電源, FG] M3×5.2 締付けトルク範囲:59~88N·cm			
ы			ツト電源部				
				34点直付け端子台			
/)	14	3 HL ±19	医酒部	[入出力電源,I/0信号]			
		入出力電源部 入出力部		M3×5.2 締付けトルク範囲:59~88N·cm			
	八田万郎		112	適合圧着端子の挿入枚数は2枚以内			
		•		平座金みがき丸付M4ネジ			
ュ	ニット取	付けネシ	,	(締付けトルク範囲: 79~108N·cm)			
				DINレールでの取付け可、6方向取付け可			
適用DINレール				TH35-7.5Fe, TH35-7.5AI (JIS C 2812に準拠)			
	ALL / IJO III O			・RAV1.25-3 (JIS C 2805に準拠)			
				[適合電線サイズ: 0.3~1.25mm²]			
油	合圧着蛸	보고.		・V2-MS3 (日本圧着端子製造(株)),			
세의	口工相和	11 1		RAP2-3SL (日本端子(株)),			
				TGV2-3N_((株)ニチフ)			
_				[適合電線サイズ: 1.25~2.0mm²]			

	, , , , , , , , , , , , , , , , , , ,					
	Item			Description		
	Protection function			None		
Output	Response time			0.5 ms or lower		
				1.5 ms or lower (resistive load)		
₹	Extern		Voltage	19.2 to 26.4 V DC (ripple ratio: within 5 %)		
0		supply	Current	24.2 mA or lower (when 24 V DC, all points ON)		
		put part		Not including external load current		
		suppress		Zener diode		
		ethod for		32 points/common (terminal block 1-wire type)		
			cocupied	1 station 32 points assignment (use 32points)		
		le power		20.4 to 26.4 V DC (ripple ratio: within 5 %)		
su	pply		Current	60mA or lower (when 24VDC, all points ON)		
No	oise du	rability		DC type noise voltage 500 Vp-p, noise width 1 µs, noise frequency 25 to 60 Hz (noise simulator condition)		
W	ithstan	d voltage		500 V AC for 1 minute between all DC external terminals and ground		
Ins	sulation	resistan	ce	10 MΩ or higher, measured with a 500 V DC insulation resistance tester between all DC external terminals and ground		
Pr	otectio	n of degre	ee	IP2X		
	eight			0.25 kg		
Comr part, l External powe		Commur part, I/O power su		7-point terminal block (two-piece) [Transmission circuit, I/O module power supply, FG] M3×5.2 Tightening torque range: 59 to 88 N·cm Applicable solderless terminals: 2 max.		
	ing stem I/O power supply part, I/O part			34-point direct-mount terminal block [I/O power supply, I/O signal] M3 × 5.2 Tightening torque range: 59 to 88 N⋅cm Applicable solderless terminals: 2 max.		
Module installation screw				M4 screw with plain washer finished round (tightening torque range 79 to 108 N·cm) Module can be mounted using DIN rail and can be mounted in 6 directions		
Applicable DIN rail			TH35-7.5Fe, TH35-7.5Al (conforming to IEC 60715)			
Applicable solderless terminal		ess	RAV1.25-3 (conforming to JIS C 2805) [Applicable wire size: 0.3 to 1.25mm²] V2-MS3,RAP2-3SL,TGV2-3N [Applicable wire size: 1.25 to 2.0mm²]			
al c	l connection)					

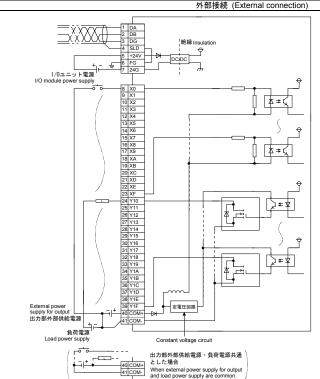

端子番号	信号名	端子番号	信号名
Terminal No.	Signal name	Terminal No.	Signal name
TB1	DA	TB21	XD
TB2	DB	TB22	XE
TB3	DG	TB23	XF
TB4	SLD	TB24	Y10
TB5	+24V	TB25	Y11
TB6	♠ (FG)	TB26	Y12
TB7	24G	TB27	Y13
端子番号	信号名	TB28	Y14
Terminal No.	Signal name	TB29	Y15
TB8	X0	TB30	Y16
TB9	X1	TB31	Y17
TB10	X2	TB32	Y18
TB11	Х3	TB33	Y19
TB12	X4	TB34	Y1A
TB13	X5	TB35	Y1B
TB14	X6	TB36	Y1C
TB15	X7	TB37	Y1D
TB16	X8	TB38	Y1E
TB17	X9	TB39	Y1F
TB18	XA	TB40	COM+
TB19	XB	TB41	COM-
TB20	XC		